

Spooky² Gen X Biofeedback

How does it work?

How do we use the results?

NOTE: At the end of this training I'll be sharing one of my personal BFB experiences.

syn·chro·nic·i·ty

/ˌsɪŋkrəˈnɪsədē/

noun

1. the simultaneous occurrence of events which appear significantly related but have no discernible causal connection.
"such synchronicity is quite staggering"

Gen X Biofeedback Scanning

Biofeedback scanning requires a frequency sweep to be input to the body, plus a system to monitor the results of this. As this sweep is being transmitted, it will kill or injure pathogens — this *makes every scan a treatment*, and you *may* experience a Herxheimer Reaction. Your body registers these events as stresses.

- With *Generator X*, these stresses result in change of current absorbed or shifts in the phase angle.

Generator X is a very sensitive and fast piece of measuring equipment that can measure small variations in current absorption and phase angle changes in the scanning signal. The Generator X is fast because it does not rely on a physiological response like the Spooky Pulse does. Spooky Pulse scans the range of 76 KHz to 152 KHz in 47 minutes. Generator X can scan this same frequency range in 2.5 minutes.

Gen X Biofeedback Scanning

- You must use TENS pads, or the Sample Digitizer or Scalar Digitizer.
- **NOTE: I'll be demonstrating how to do the scan with TENS pads and the Sample Digitizer – because I have used both those methods and can speak from experience. Using the Scalar Digitizer is something that I have not done**
- The TENS pads should be as close together as possible, with the pathogens between the two pads.
- *The best scan results come when you use a baseline scan.* [Using a baseline is up to some debate and I'll speak of my personal experience about this subject] To include a baseline scan in your scan, first tick the Baseline Before BFB checkbox. Then click the Scan button, and a baseline is performed before the biofeedback scan. This will double the scan time of the GX Fast Biofeedback Scan (C) -JW, and increase by 50% the scan time of the GX General Biofeedback Scan (C) - JW. The scan preset GX General Biofeedback Scan with Baseline (C) - JW includes a baseline, and because it only does one loop, it takes the same time as the GX General Biofeedback Scan (C) - JW preset.

NOTE: If a scan is interrupted, you must restart it from scratch. Scans cannot be paused once they've started.

Gen X Biofeedback Scanning

Before you scan, you must first stop or pause all generators operating in Remote Mode because you should only be receiving the input scan sweep frequencies, and no others.

Gen X Biofeedback Scanning

Now load the biofeedback scan preset for your scanning hardware. This will set up your generator correctly.

Note that if you edit a biofeedback preset, or make your own custom biofeedback preset, you must save the biofeedback preset in the Biofeedback folder inside the User folder. If you don't do this, your custom settings will not be restored correctly when you click on the preset. This applies to custom biofeedback presets only because biofeedback parameters are global.

For GeneratorX, you must use TENS pads or the Sample Digitizer. [There is debate on this subject and I'll address that subject as well.]

You cannot use Spooky Central/Plasma to input any scan sweep because the plasma tube's energy will freeze Spooky Pulse, preventing it from doing its job.

Gen X Biofeedback Scanning

Depending on your Spooky² rig, scanning every **seven** or **four** days is highly recommended. Spooky **Central/Plasma** users should use the results program in a **killing preset** and run it **once a day for four days**, then **scan again**. **Contact Mode** users should run it **once daily for seven days**, then **scan again**. **Remote Mode** should be **run non-stop for a week**, then **scan again**.

Repeated scans are necessary, and here's why: **The human body**, it may surprise you to learn, **is made up of more than 50% bacterial cells**. **Most** of these **organisms are harmless**, **some** are **beneficial**, and **some cause disease**. Spooky² *is not capable* of **telling the difference** between them — it can only report how big a stress the destruction of each caused in your body. To put it another way, it lists the organisms that “screamed loudest.” But there's no guarantee that these are the nasty ones. In fact, **serious pathogens are often able to hide from your immune system** because they've developed stealth strategies. So while they may be hit and killed, their presence might not register over the “noise” of trillions of other bacteria, all of which are also being hit.

Repeated scans are necessary to “clear the stage” of all the loud and melodramatic organisms first. When that's done, Spooky2 can now “hear” the bad guys clearly.

Biofeedback scanning is like peeling an onion, layer by layer.

Gen X Biofeedback Scanning

From this point forward - many of the slides are taken from a PDF document titled
Gen X Scan ver5.0

by
Jeff Kaczor and Ed Von

Please download the latest software version "**Spooky2_Setup_20210729**" from
<https://www.cancerclinic.co.nz/downloads.html>


Step-by-Step Live Demonstration – begins now...

PDF - attached in the comments area


Gen X Biofeedback Scanning

Although I'm concentrating this evening on the use of the **Contact** method of doing Biofeedback – the set up for using the **Sample Digitizer** is essentially the same. **Both require the Generator X** – so let's take a quick look at using the Sample Digitizer before I start with the contact method...


On the **Preset Tab**
click on **Biofeedback**.

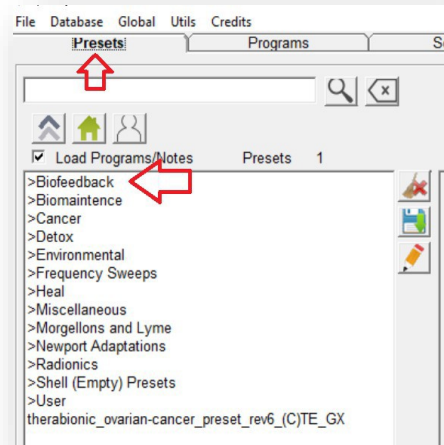

Select
Sample Digitizer

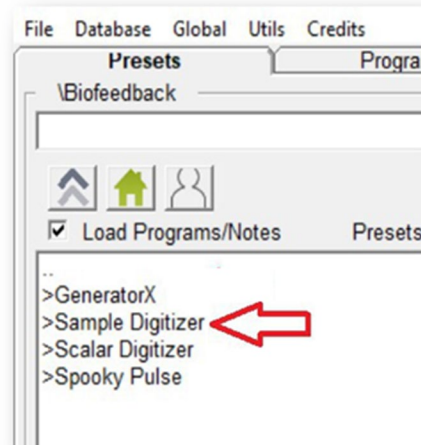

Select
General Biofeedback Scan (SD)-JW

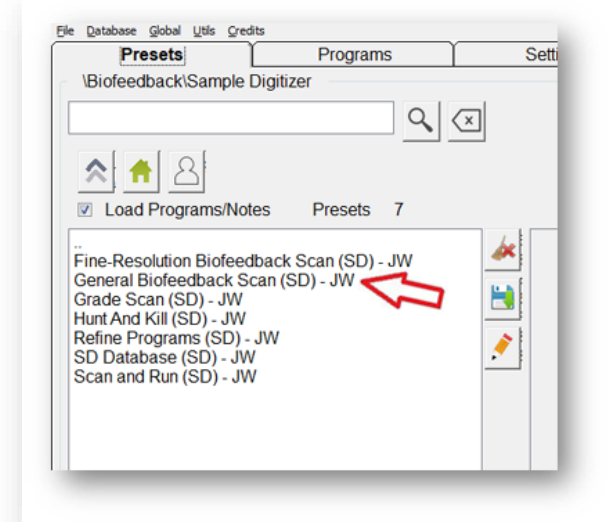

Spooky2 Coupon Code 0804Ellis - Good through 090321

Gen X Biofeedback Scanning

In this presentation I will assume that you have already figured out how to connect the generator to your PC, and how to use tens-pads. If these things are not so – open the PDF and take a look at the first page. The setup instructions are included there.

...now we'll move on - to the contact method as described in the PDF


1. - a. *Plug TENS cable into Out 1*, of either Gen 1 or Gen 2 (*Boost not used for scans*)
 - *b. Plug Generator X Power Adapter* (12 Volt power adapter) into the wall circuit, and then into the Generator X, **making sure** that the Gen X adapter says for Gen X and is 12 volt. (The Blue XM generator uses a different adapter, 5 volts with less power.)
 - *c. Plug the USB cable into the Generator X and the Computer*
2. - *Plug Pads into the other end of the cable with the TENS pad connectors*



Gen X Biofeedback Scanning

In this presentation I will assume that you have already figured out how to connect the generator to your PC, and how to use tens-pads. If these things are not so – open the PDF and take a look at the first page. The setup instructions are included there.


3. Place the pads on your kidneys below the Rib cage **OR on either side of the location of the problem area** with the cables about 6" apart trying to keep the pads close to each other but within the problem area.

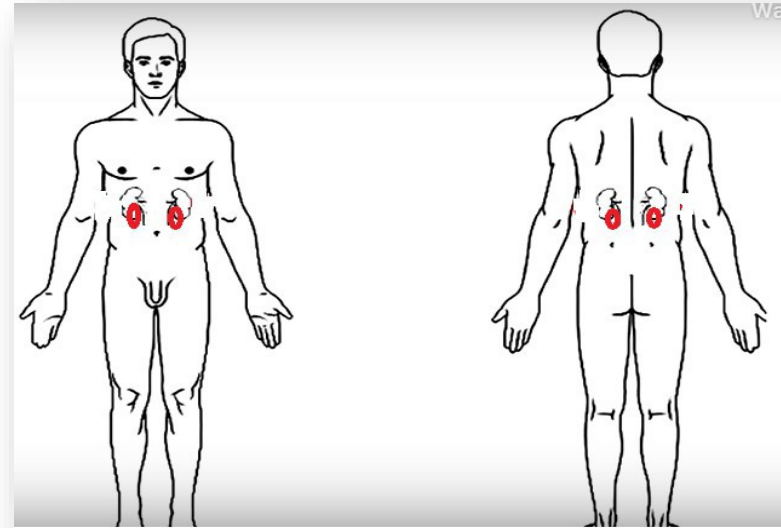

NOTE: If you're like me and have several Generators running – it's helpful to pause them while setting up for Biofeedback – or really when creating presets or new programs.


Gen X Biofeedback Scanning

4. The TENS cable is long, allowing the TENS pads to be placed far apart, but long cables pick up more electrical noise. Twisting the wires together and placing the TENS pads closer reduces the noise going back to Generator X

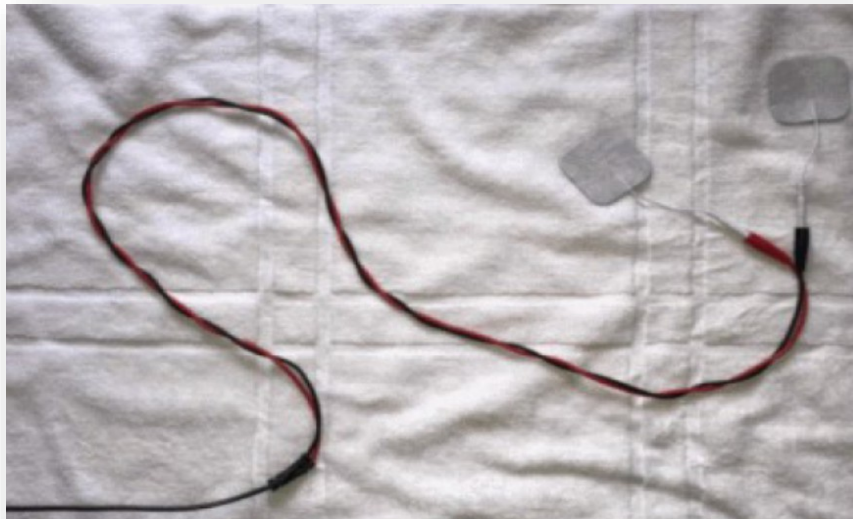

5. Turn on Generator
6. Start the Spooky 2 Program on your computer


NOTE: While it's a good thing to have the generator on *before* starting the program so that it's recognized by the software - no one needs to panic over the order of doing things: If the software is already running and you then connect the generator – you can always go to the **Utilities** tab and click **Rescan** devices.-)

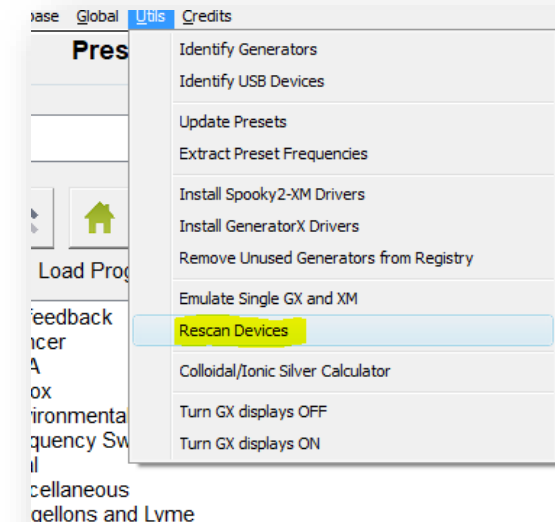


Gen X Biofeedback Scanning

Notice the similarity here to the Sample Digitizer setup? Yeah – all this stuff actually makes good logical sense:-)


8. On the **Preset Tab** click on Biofeedback.

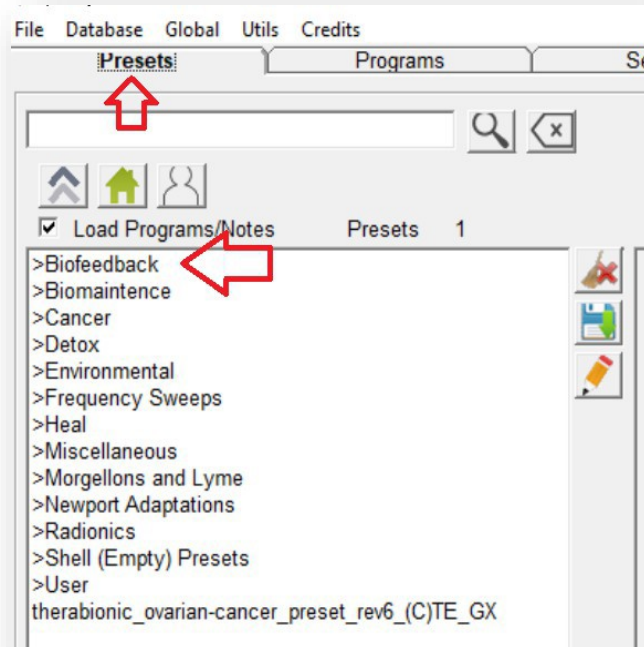

Select **GeneratorX**

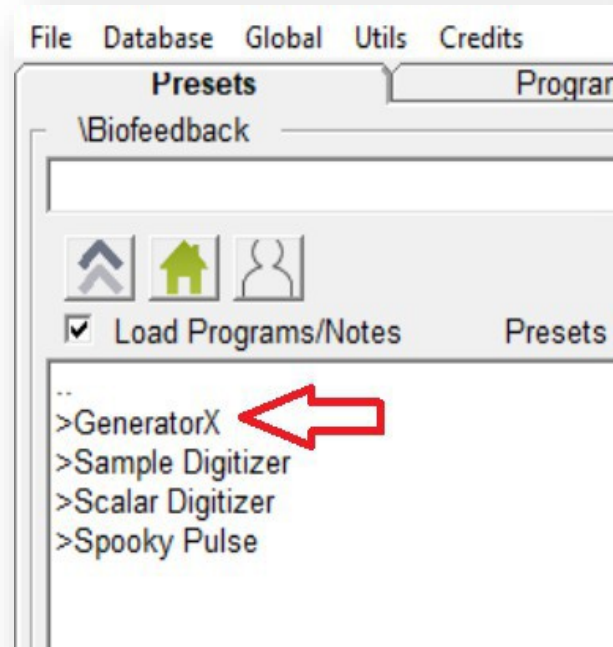


9. Select **GX High Frequency Biofeedback Scan (C)-JW** (This spans a large frequency area and covers the higher cancer frequencies better than the other scans)

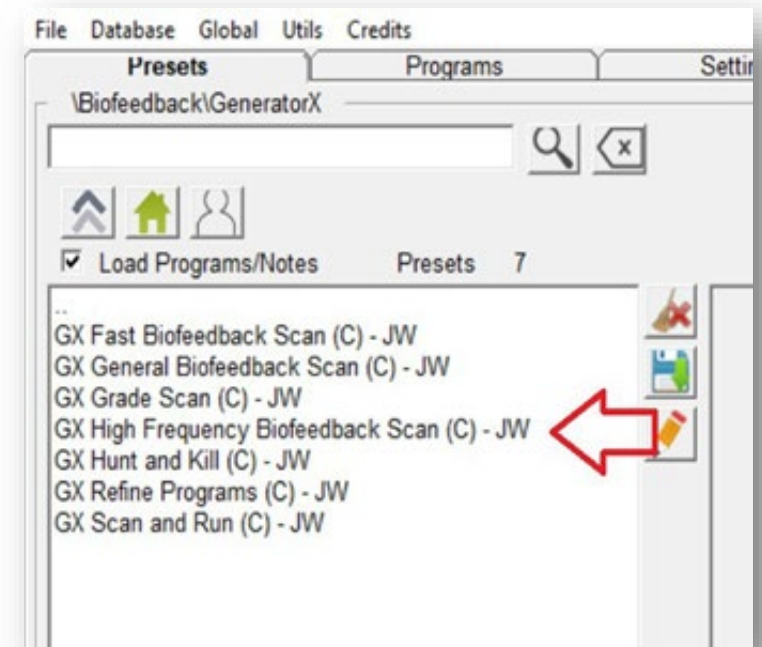

Gen X Biofeedback Scanning


10. Go to the **Control Tab** and Select **Overwrite Generator** and click on your **Generator** (the one that has your TENS cables attached)

...and, while not necessary - it's helpful to put in a **Log Name**

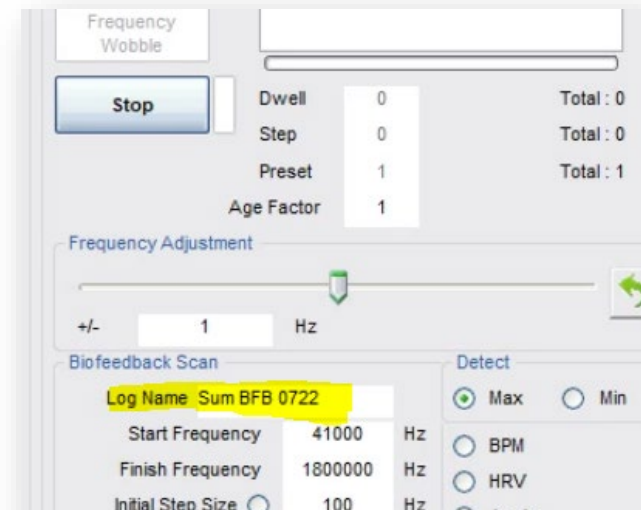

Gen X Biofeedback Scanning


11. Click the **Scan** button

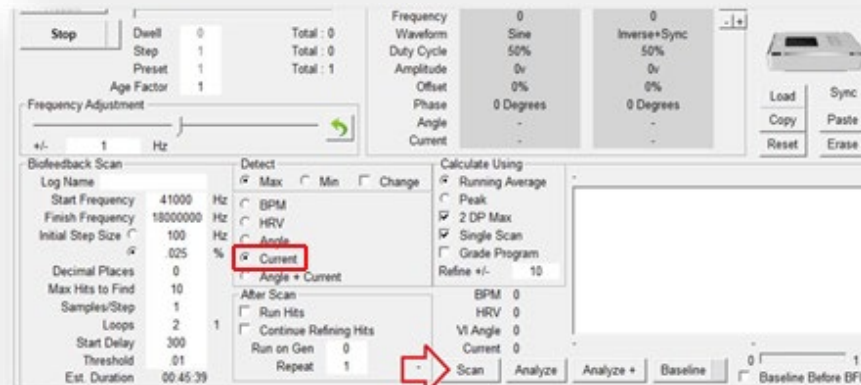

Notice that Current is the default scan being analyzed

It is suggested that Baseline not be used. Find more details on the PDF.

When the scan has completed - a window will appear:

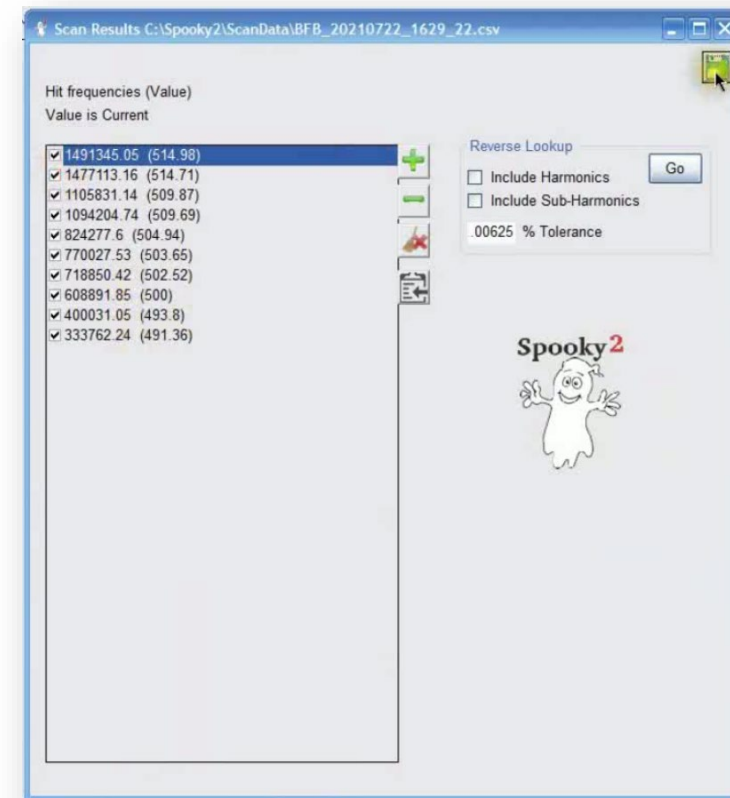


Click the **Save** Icon

Gen X Biofeedback Scanning

The following passage is a direct copy/paste from the new PDF

How to make Frequency Programs using GenX

1. Go to the Analyze Button on the Control tab and *click Analyze* (Note please: it is best if the High Frequencies Scan is selected First and then You go to the **Control** tab, Select **Allow Overwrite**, and **Select the Generator and Analyze**, this is necessary, mistakes have been made by not doing this first, If You have already done this for a scan, no worries, if starting out to just analyze, please do this).
2. Pick the scan that you have just made. Ten frequencies will appear with the top most important downward.
3. **Create a frequency Program** by clicking *first* on this icon upper right corner

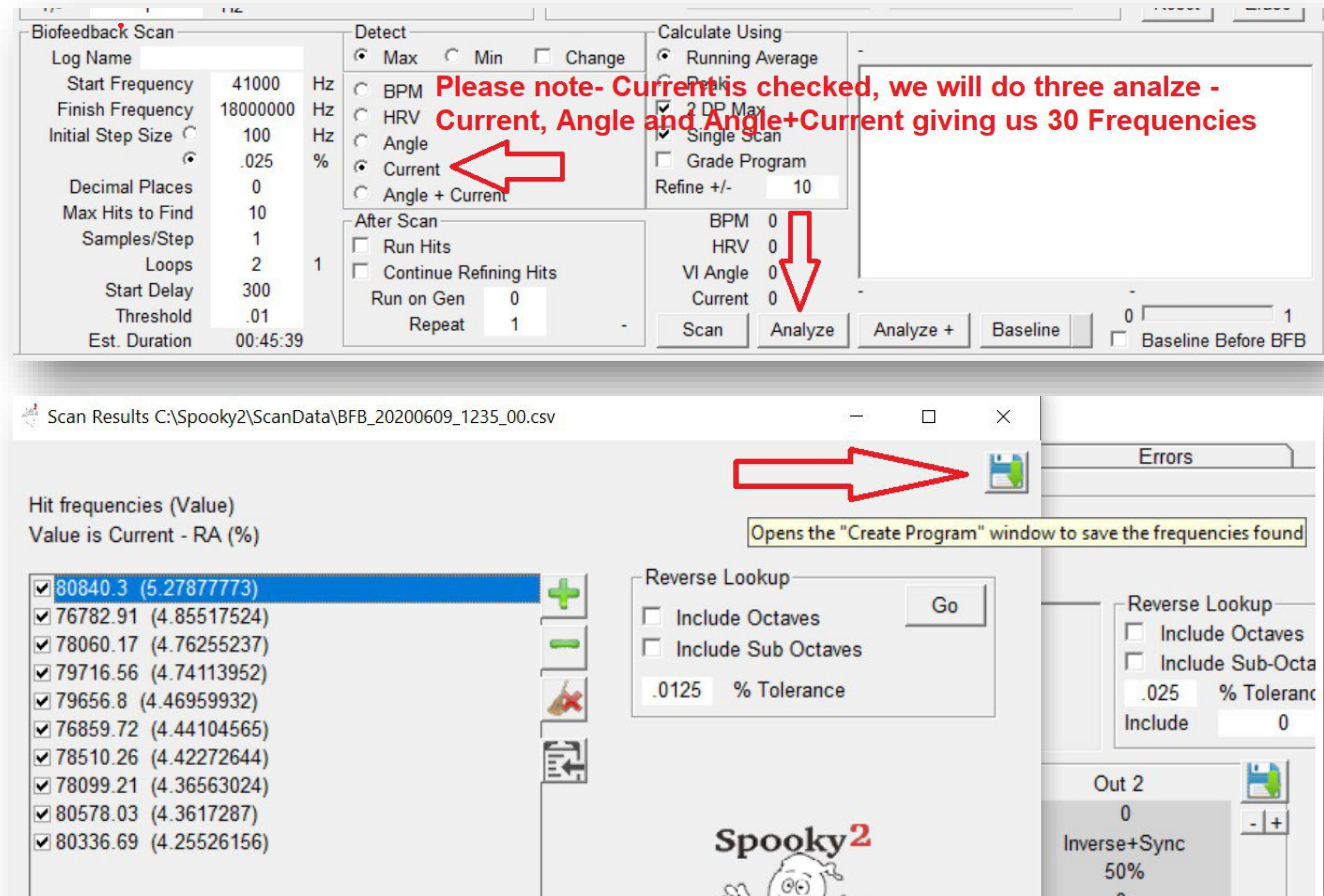

Gen X Biofeedback Scanning

So yeah, here's the way I've been doing it
Confused? No worries - I'll demonstrate:-)

When you click that Save button – another window will show up.
If you already put a **Log Name** (with the date included) in earlier – it will display at the beginning – in front of some automatically generated code. Delete the code and add the word, “**Current**” -
Then Click **Save... - It will save to your BFB folder.**

The screenshot shows the 'Create Program' window in the Spooky2 software. The 'Program Name' field contains 'Sum BFB 0722'. A red arrow points to this field. A blue arrow points to the 'Add the program to the Custom database' button. A second window is overlaid on the right, showing the 'Program Name' field with 'Sum BFB 0722 - Current' and a red arrow pointing to it.

Give your program a descriptive name. This will assist you when you do a program search.

Program Name

Sum BFB 0722

Frequencies (and optional advanced commands) are entered using a comma to separate each program step.

xxx-yyy Sweeps the frequency from xxx Hz to yyy Hz.
=xxx x is the dwell (seconds) this frequency is to be applied. Example: 2127=180,2128=240,2127-2128=600
Wx x is the waveform for this frequency. W sets Out 1 and w sets Out 2. The values of x for when specifying the waveforms are:
1 for Sine.
2 for Square.
3 for Sawtooth.
4 for Inverted Sawtooth.
5 for Triangle.
6 for Damped Sinusoidal.
7 for Damped Square.
8 for H-Bomb Sinusoidal.
9 for H-Bomb Square.
10 for User Defined #1
11 for User Defined #2

Frequencies

80840.3,76782.91,78060.17,79716.56,79656.8,76859.72,78510.26,78099.21,80578.03,80336.69

Enter the default duration (in seconds) you wish to apply each frequency.

Dwell

360

Any notes for this program should be entered here. Spooky2 will include this in searches.



Program Description

Program Created 7/31/2020 This is the Current program, next will do Angle, and then Angle and Current


Gen X Biofeedback Scanning

Go back to the **Control** tab and tick the **Angle** radio button.
Then click **Analyze**

The software will ask what you want to analyze by bringing up your **ScanData** folder. – Click and open the BFB you just completed. Its Date and Time will inform your choice, right?-)

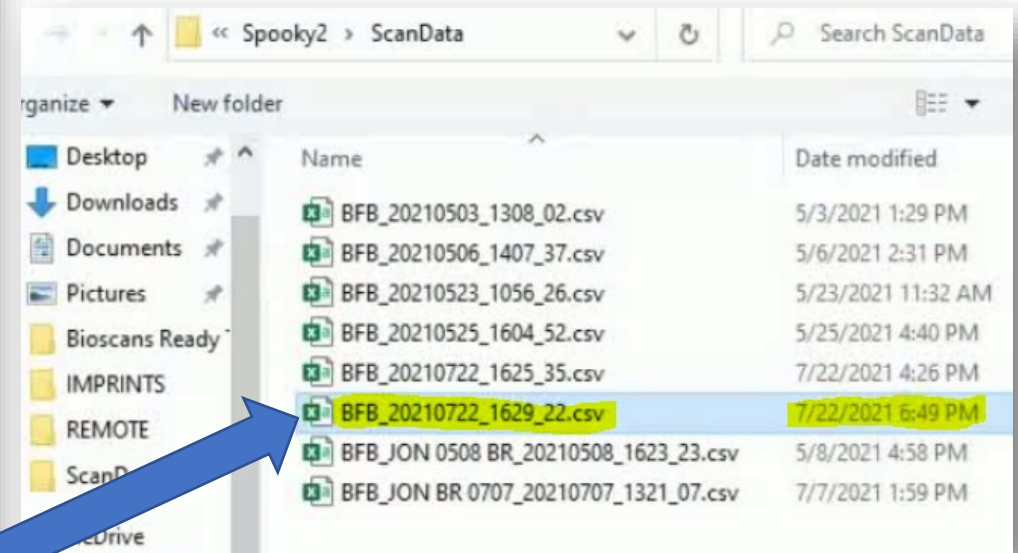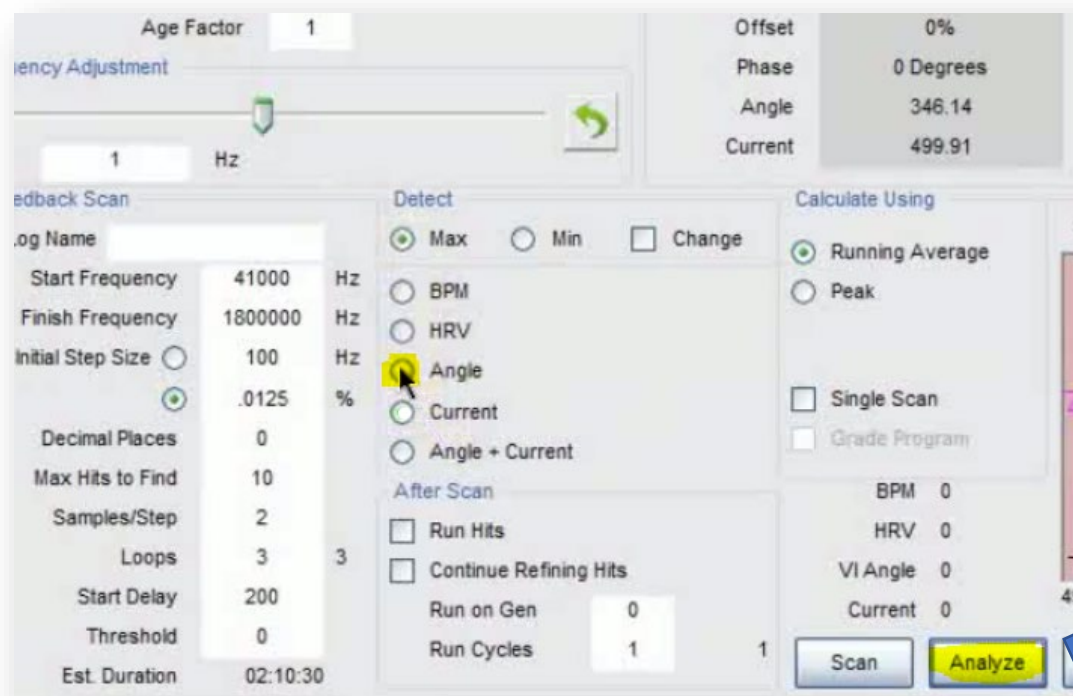

Gen X Biofeedback Scanning

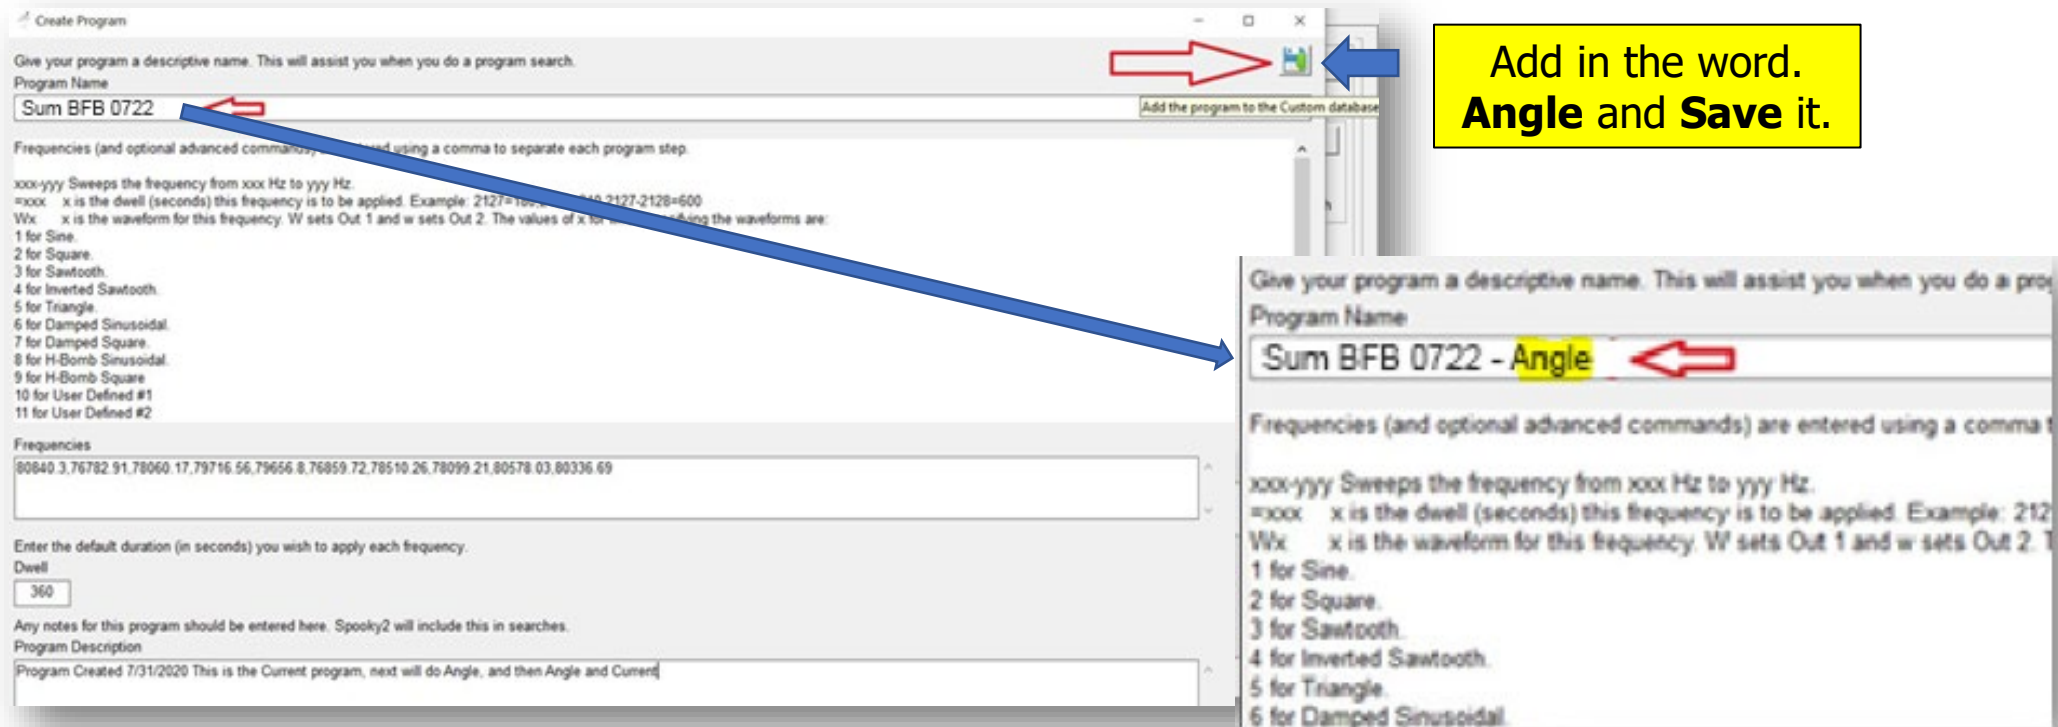

Gen X Biofeedback Scanning

Do the same thing one last time ticking the radio-button that says
Current + Angle – and **Save** that as well.

Create Program

Give your program a descriptive name. This will assist you when you do a program search.

Program Name
Sum BFB 0722 - Angle&Current

Frequencies (and optional advanced commands) are entered using a comma to separate each program step.

xxx-yyy Sweeps the frequency from xxx Hz to yyy Hz.
=xxx x is the dwell (seconds) this frequency is to be applied. Example: 2127=180,2128=240,2127-2128=600
Ww x is the waveform for this frequency. W sets Out 1 and w sets Out 2. The values of x for when specifying the waveforms are:
1 for Sine.
2 for Square.
3 for Sawtooth.
4 for Inverted Sawtooth.
5 for Triangle.
6 for Damped Sinusoidal.
7 for Damped Square.
8 for H-Bomb Sinusoidal.
9 for H-Bomb Square.
10 for User Defined #1.
11 for User Defined #2.

Frequencies
80840.3,76782.91,78060.17,79716.56,79656.8,76859.72,78510.26,78099.21,80578.03,80336.69


Enter the default duration (in seconds) you wish to apply each frequency.
Dwell
360

Any notes for this program should be entered here. Spooky2 will include this in searches.
Program Description
Program Created 7/31/2020 This is the Current program, next will do Angle, and then Angle and Current

Add the program to the Custom database

Now, you're ready to run those 30 frequencies as a single Preset.

Gen X Biofeedback Scanning

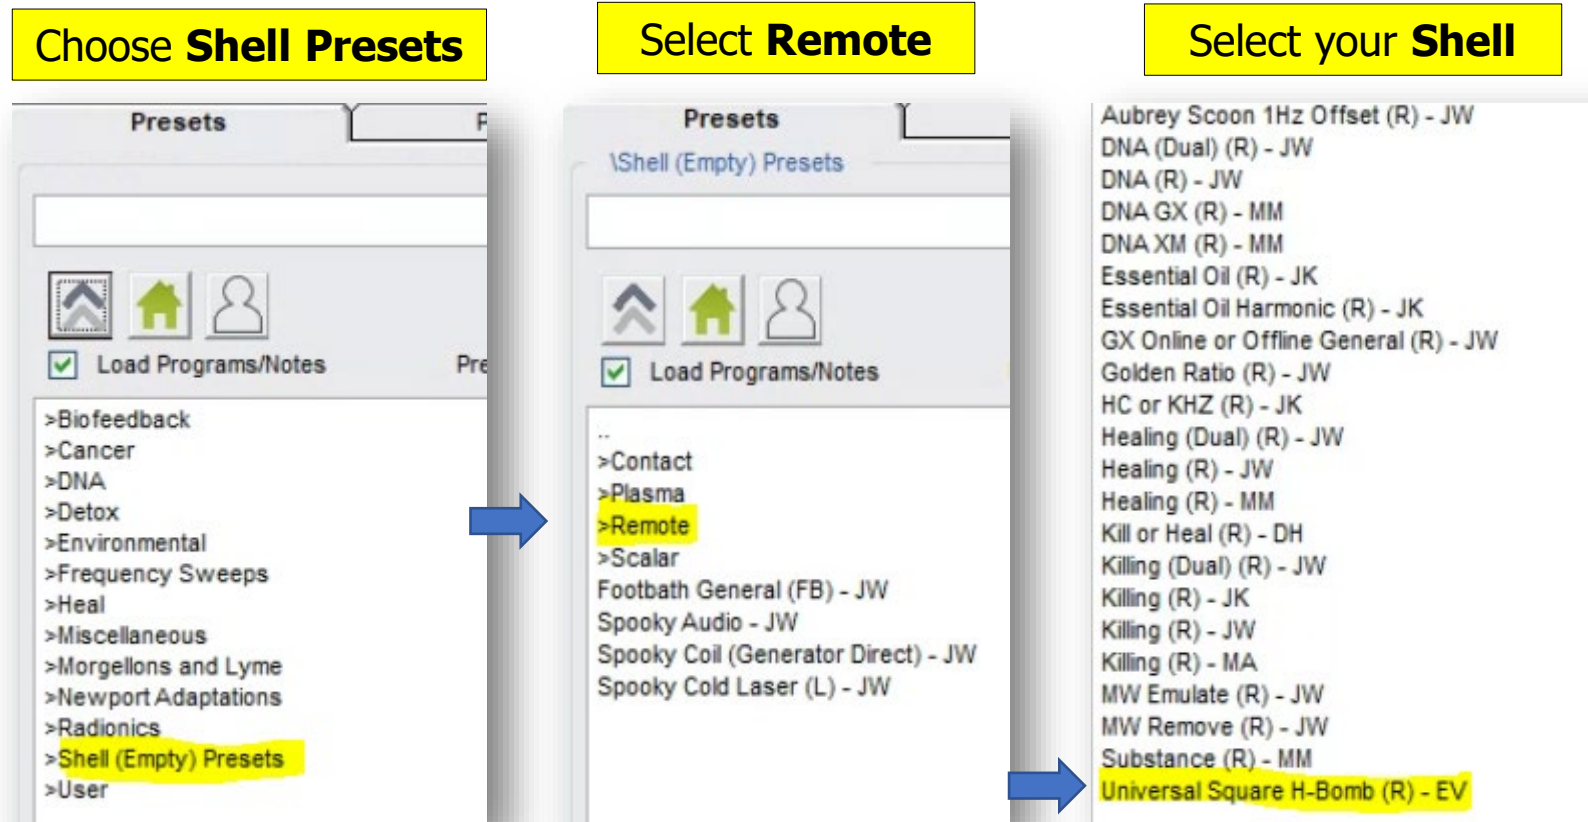

Gen X Biofeedback Scanning

1

The screenshot shows the Gen X Biofeedback Scanning software interface. At the top, there are tabs for Presets, Programs, Settings, Control, System, Internet, and Errors. Below the tabs is a search bar with the text "sum" and a magnifying glass icon. To the right of the search bar is a "Database" section with a list of checkboxes: ALT, BFB (checked), BIO, CAFL, CUST, DNA, ETDFL, HC, KHZ, MW *, PROV, RIFE, SD, VEGA, and XTRA. A yellow box with a question mark icon is at the bottom of the database section. Below the database section is a "Loaded Programs" section with a list of programs: Sum BFB 0722 Current (BFB), Sum BFB 0722 Angle LOL! (BFB), and Sum BFB 0722 Angle&Current (BFB). At the bottom of the interface is an "Options" section with a list of settings: Repeat Each Frequency (1), Repeat Each Program (1), Repeat Sequence (0), Repeat Chain (0), Out 1 (0), Out 2 (0), Hz (0), Secs Between Freq (0), Run (unchecked), Remove Duplicate Frequencies (unchecked), and Apply Tissue Factor to DNA Frequencies (unchecked). A yellow box with a question mark icon is at the bottom of the options section. A yellow box with a question mark icon is also present in the top right corner of the interface.

1. If you wish - you can use the person's name to search.

2. Click the "-" to eliminate all databases.

3. Then tick **only the BFB** box.


4. Find the three different programs you created and Load them.

5. Change "Repeat Sequence" to zero (this is only for Remote).

Gen X Biofeedback Scanning


6

If you wish - on the **Settings** tab change **Harmonic Wobble** to .02% Feathering. Why not cover overlapping frequencies, right?

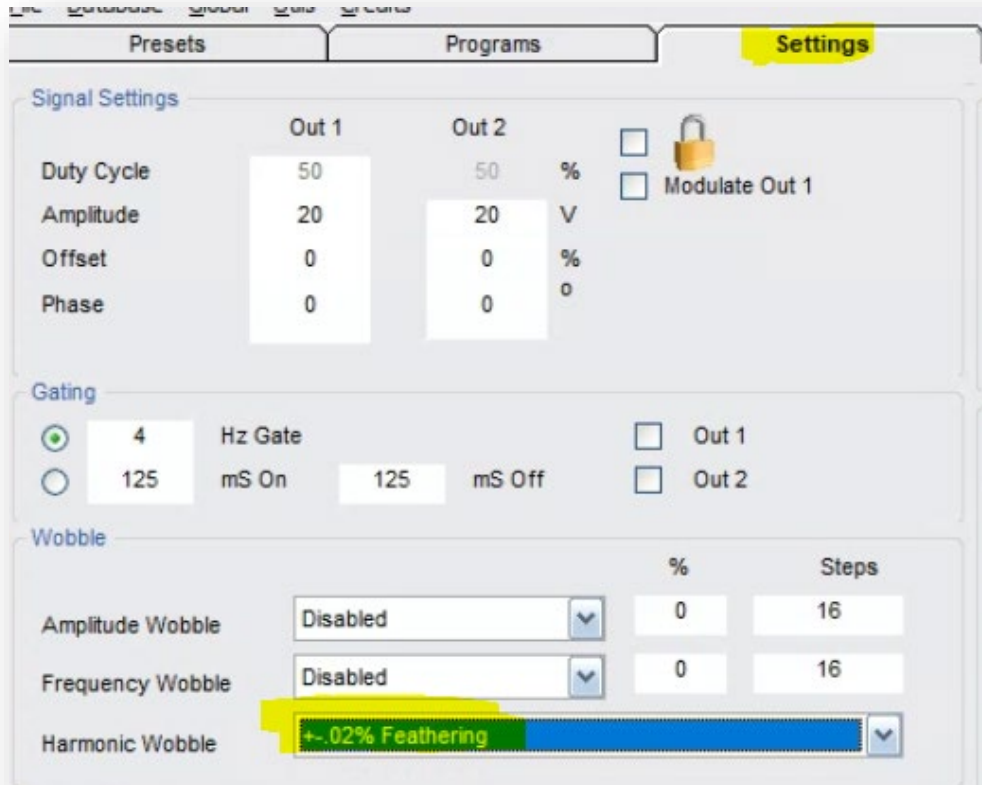

7

Back on the **Presets** tab - Click to **Save your new Preset**

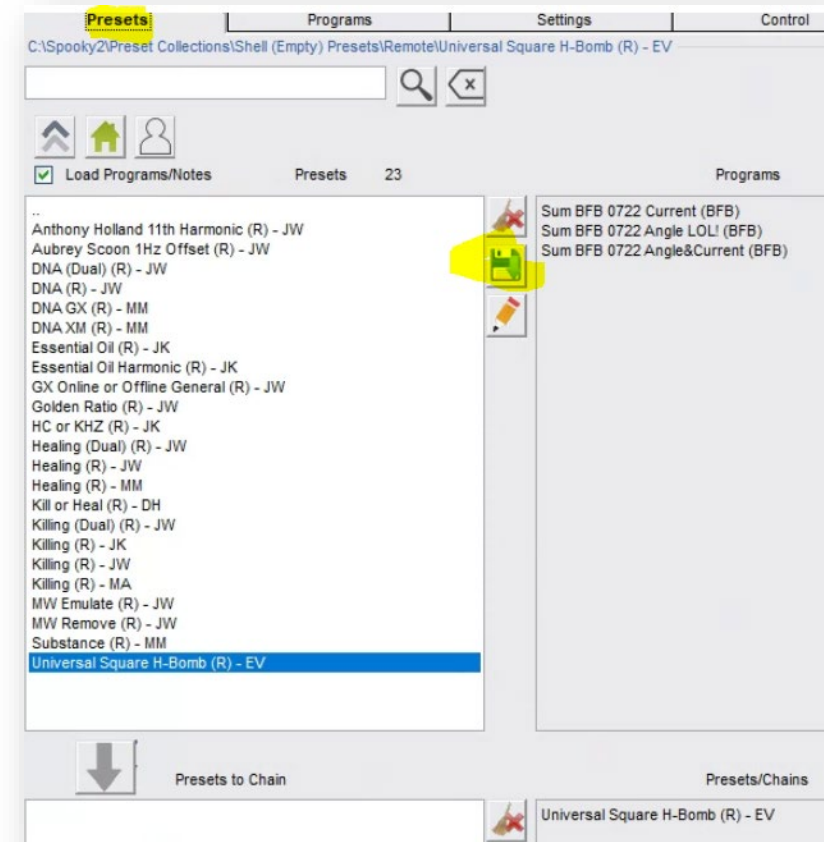

Gen X Biofeedback Scanning

This is a copy/paste directly from the PDF – again, I will demonstrate.-)

Make a Preset Program

*1. Go to Preset Screen, select **Shell Empty Presets**, and select the modality you want to run, **Contact, Remote, or Plasma***

Suggested presets

- for: ***Remote:*** Universal Square H-Bomb (R) – EV
- for: ***Plasma :*** Spooky Plasma Entrainment and Healing (P) – JW
- for: ***Contact:*** Universal Square H Bomb (C) EV


2. Attach the boost to the Gen X to Run Remote or Contact

Now go to Program Screen, go down to the bottom frequencies, and you should see the programs you just made, ***select Contact, Angle, and Angle and Contact***, this will give you ***30 frequencies*** – if you have trouble finding the presets(The should be at the very bottom of the programs, you can scroll down to find) or go over to Database, unselect all (-), then select ***BFB frequencies*** and all your made programs from scans should show.

Gen X Biofeedback Scanning


NOTE: While General BFB scanning placement of the tens pads works well around the kidneys - if you wish to treat something specific - then you'll want to place the pads as close to either side of that location as possible.

Running the results in a new preset I suggest that placement of the pads **just under the collar bone**, on the **shoulders themselves** (off the bone), or **just above the shoulder blades** – all are very effective in treating the body as a whole. I discovered this when using other rife machines, and have used it effectively with Spooky².

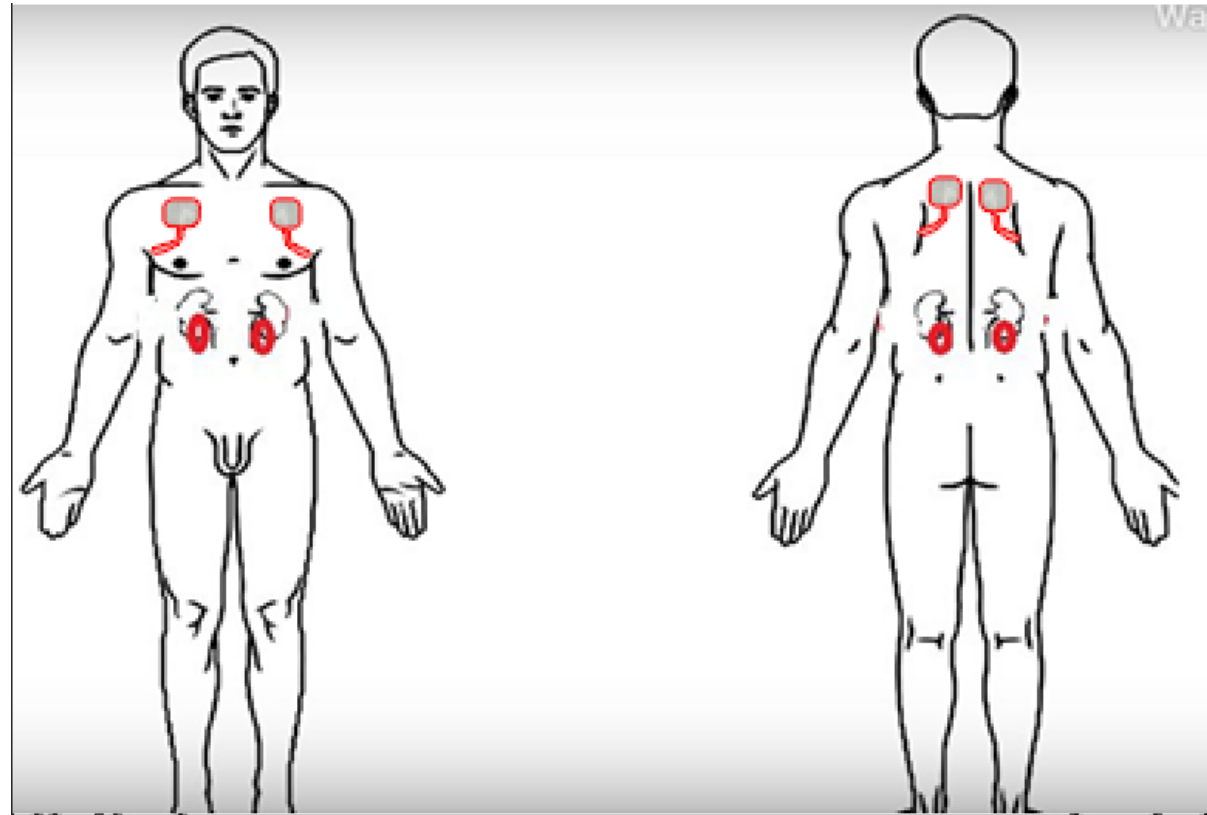

Gen X Biofeedback Scanning

Run your newly created Preset, and then repeat this exact same process a few days later. Then run the new set of frequencies right along with the first set. Let them overlap. I actually did this three times as opposed to just twice - and let them all overlap. When doing this it's a good idea to tick **Remove Duplicate Frequencies** under **Options** on the **Programs** tab. Sometimes reduces the time it takes to run those frequencies – while other times there are simply no duplicates.

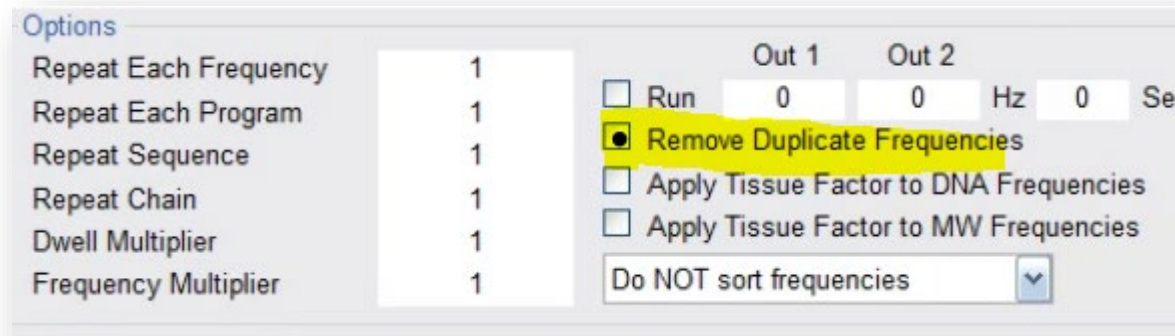

Gen X Biofeedback Scanning

...and now, we're back to synchronicity.

As promised – now I'll share exactly how I used this process, and the results I achieved. Once again I've proven to myself the power of this equipment, not only its ability to target what was necessary, but also the stunning power of the Remote functionality.



Gen X Biofeedback Scanning

That's it!

Did I forget anything?

Did I get anything wrong?

Probably.-)

That's okay – we can talk about it.

Any and all questions are welcome.

For those watching this as a recording or anyone who has additional questions please feel free to write to me

jon@rifework.com